







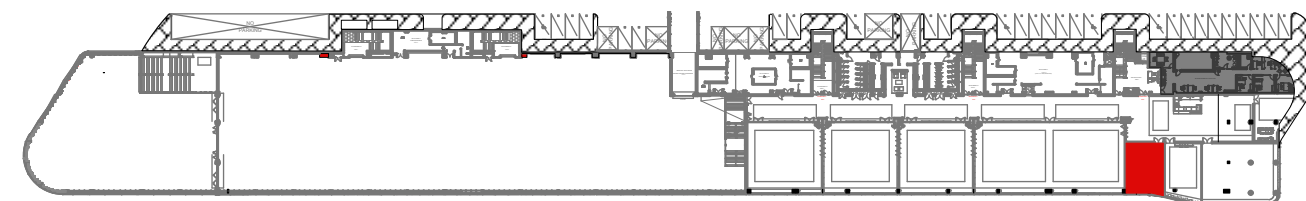
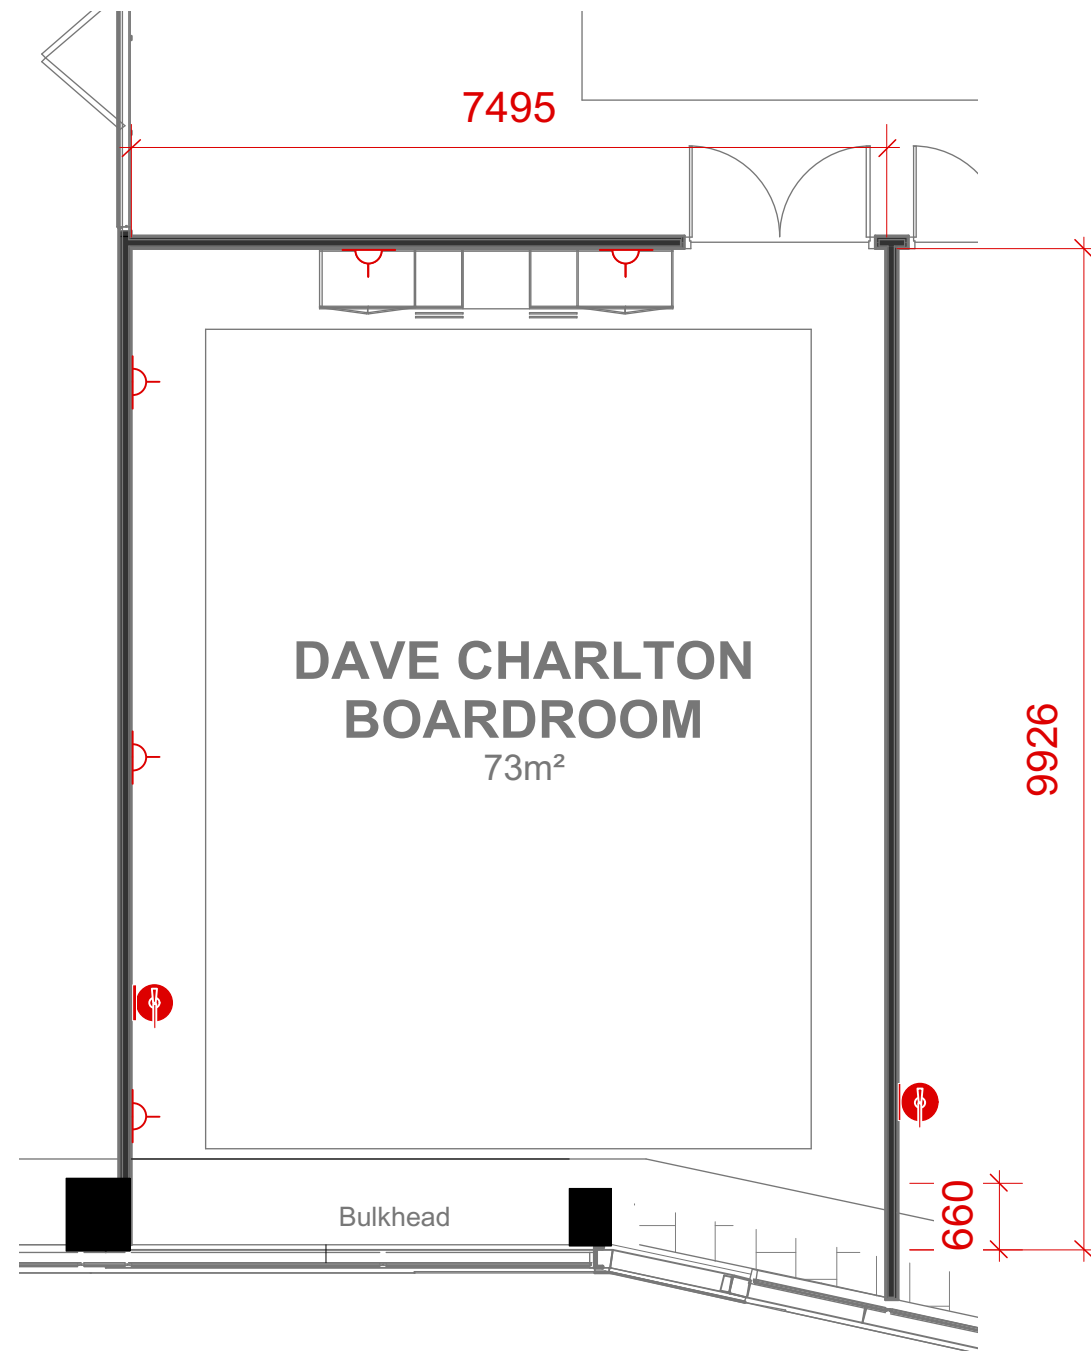


Venue Heights:
 3100 to Lowest Point on Ceiling
 2640 to Lights
 2180 to Bulkhead

Symbol:	Description:	Qty:
	Fire Hose Reel	x
	Fire Extinguisher	1
	Single Socket 1 Phase Power Outlet	4
	Double Socket 1 Phase Power Outlet	x
	16A 3 Phase Power Outlet	x
	32A 3 Phase Power Outlet	x
	63A 3 Phase Power Outlet	x
	Public Announcement System	x



Venue » Pit Building
» Lvl 1: Dave Charlton Boardroom
Scale » 1:75
» A3